



County of San Diego
Planning & Development Services
BUILDING DIVISION

ACCESSIBILITY CORRECTION LIST

Multifamily Housing

12A

Public Telephones

RECORD ID:

OWNER ON APPLICATION:

SCOPING

1. Public telephones provided in common-use spaces shall be accessible per the following:
 - ☐ On floors where public telephones are provided, at least one accessible telephone required
 - ☐ On floors where two or more banks of multiple telephones provided, at least one accessible telephone required in each bank

CBC 1140A.1

VOLUME-CONTROL TELEPHONES

2. Where public telephones are provided in common-use areas, identify at least one telephone equipped with volume control on each floor or in each bank, whichever is more.

CBC 1140A.6
3. Specify volume-control telephones complying with the following:
 - ☐ Receiver generating magnetic field in area of receiver cap
 - ☐ Hearing-aid compatible
 - ☐ Minimum 12 decibels and maximum 18 decibels above normal

Exception: 18 decibels may be exceeded if an automatic reset is provided

 - ☐ Identified by signage per CBC Figure 11A-11D



FIGURE 11A-11D
VOLUME CONTROL TELEPHONES

CBC 1140A.6

THIS DOCUMENT IS FOR PLAN REVIEW ONLY.
CORRECTION LIST ITEMS AND FIGURES MAY NOT BE REPRODUCED OR COPIED ON PLANS.
IF CONFLICTS EXIST BETWEEN CODE TEXT AND FIGURES, THE CODE TEXT SHALL GOVERN.

5510 OVERLAND AVE, SUITE 110, SAN DIEGO, CA 92123 • (858) 565-5920 • (888) 336-7553

[HTTP://WWW.SDCPS.ORG](http://www.sdcps.org)

TEXT TELEPHONES

4. If a total of four or more public telephones are provided at the interior and exterior of a site – with at least one at an interior location – specify at least one interior phone as a text telephone and identified by signage per CBC Figure 11A-11C.



FIGURE 11A-11C
INTERNATIONAL TTY SYMBOL


CBC 1140A.7

DIMENSIONS AND CLEARANCES

5. Dimension wheelchair clear floor/ground space complying with the following at each accessible telephone:
 - ☐ Minimum 30 inches by 48 inches
 - ☐ Allowing forward or parallel approach
 - ☐ One full unobstructed side adjoining another wheelchair clear floor/ground space

CBC 1140A.2 and CBC 1140A.3


6. Dimension telephone mounting height and any enclosures per the following:
 - ☐ Where only forward approach allowed, per CBC Figure 11A-11B(c)

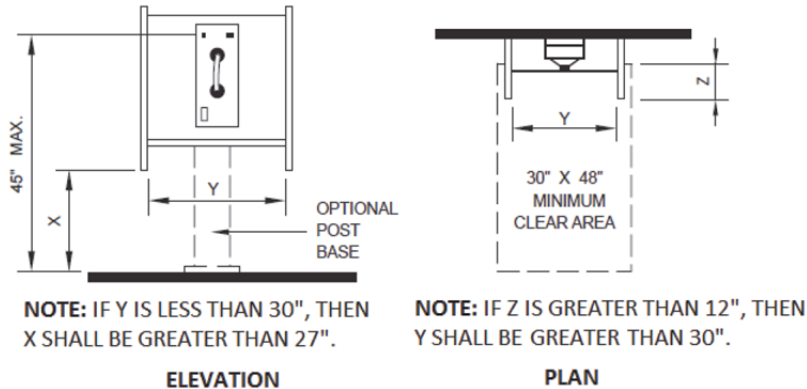

(c) FORWARD REACH ARRANGEMENT

FIGURE 11A-11B
MOUNTING HEIGHTS AND CLEARANCES FOR TELEPHONES


- ☐ Where parallel approach allowed, per CBC Figure 11A-11B(a)

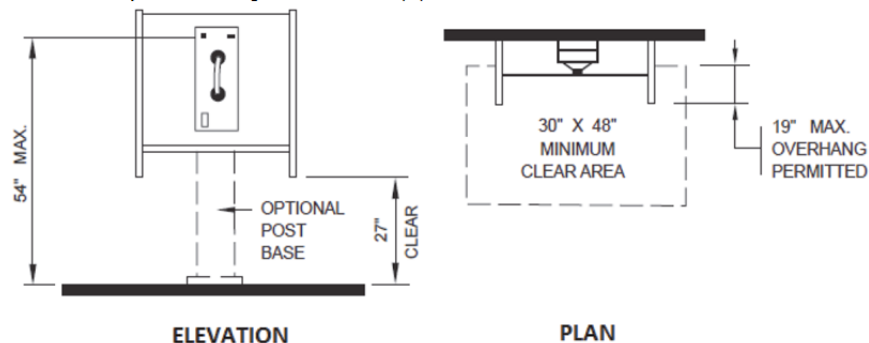

(a) SIDE REACH ARRANGEMENT

FIGURE 11A-11B
MOUNTING HEIGHTS AND CLEARANCES FOR TELEPHONES

- Where enclosure is full-height or telephone mounted in corner requiring wheelchair users to reach diagonally, per CBC Figure 11A-11B(b)

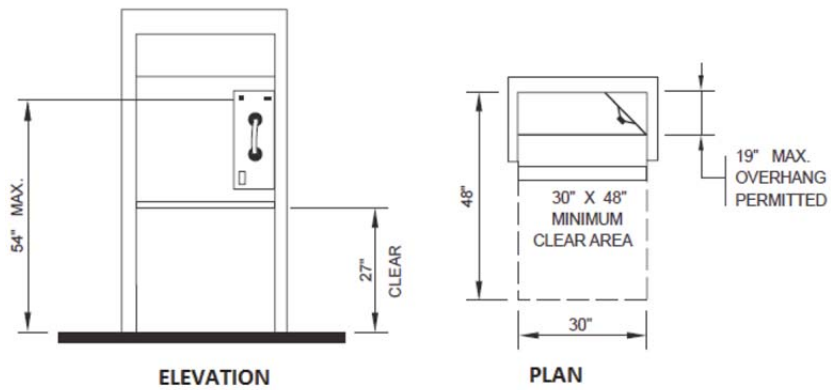

(b) FULL HEIGHT ENCLOSURE

**FIGURE 11A-11B
MOUNTING HEIGHTS AND CLEARANCES FOR TELEPHONES**

CBC 1140A.4

7. Specify minimum 29-inch-long cord from phone to handset.

CBC 1140A.9

8. Specify push-button telephone controls where service available.

CBC 1140A.8